

Zhejiang Jiashi Yi Bao Board Company Limited

TEST REPORT

SCOPE OF WORK

ABA floor

REPORT NUMBER

190522010SHF-002

TEST DATE(S)

2019-05-23 - 2019-05-23

ISSUE DATE

2019-06-11


PAGES

6

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-10k(May 1, 2019)

© 2019 INTERTEK

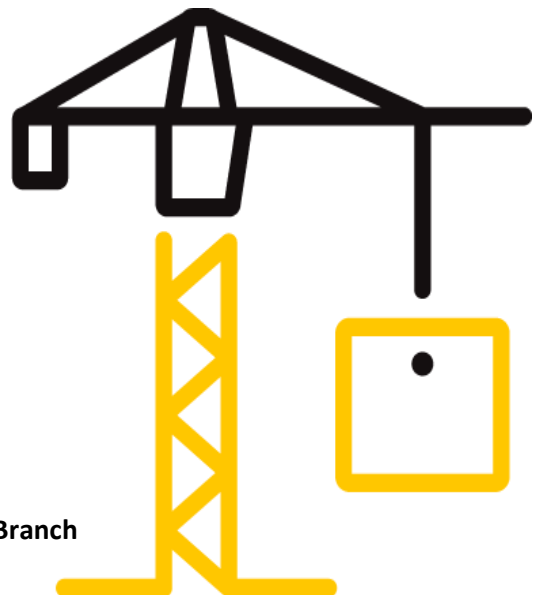

Test Report

Statement

- 1.This report is invalid without company's special seal for testing on assigned page.
- 2.This report is invalid without authorized person's signature.
- 3.This report is invalid where any unauthorized modification indicated.
- 4.Don't copy this report in partial (except full copy) without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.
- 5.Any holder of this document is advised that this report is for the exclusive use of Intertek's Customer and is provided pursuant to the agreement between Intertek and its Customer. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. This report was made with due care within the limitation of a defined scope of work and on the basis of information, materials and instructions received from the Customer or its nominated third parties. Intertek is under no obligation to refer to or report upon any facts or circumstances which are outside the specific instructions received and accepts no responsibility to any parties whatsoever, following the issue of the report, for any matters arising outside the agreed scope of the works. The tests results are not intended to be a recommendation for any particular course of action. Customer is responsible for acting as it sees fit on the basis of such results.
- 6.Intertek's written consent is required to use Intertek's name or logo on the object, product or service being tested. The observations and test results in this report relate only to the sample under test. This report alone does not indicate that the item, product or service has passed any Intertek certification program.

Test Report

Issue Date: 2019-06-11 Intertek Report No. 190522010SHF-002
 Applicant: Zhejiang Jiashi Yi Bao Board Company Limited
 Address: Shide Industrial Park, Big Bridge New Area, Zhejiang Haiyan Economic Development Zone
 Attn: Huanhuan Wang
 Test Type: Performance test, samples provided by the applicant.

Product Information

Product Name	ABA floor	Brand	实德地板
Sample Description	Good Condition	Sample Amount	15 m ²
		Received Date	21-May-2019
Sample ID	Model	Specification	
S190522010SHF.002	/	1213*177*6.0mm+1mm	

Test Methods And Standards

Test Standard	ASTM E492-09(R2016) ^{e1}
Specification Standard	ASTM E989-18
Test Conclusion	The samples were tested according to the above standards, and the results are shown in the following page.

Note:

1.This report relates specifically to the sample(s) that were drawn and provided by the applicant or their nominated third party. The reported result(s) provide no warranty or verification on the sample(s) representing any specific goods and/or shipment and only relate to the sample(s) as received and tested.

Report Authorized




 Name: Jodie Zhou Name: Mason Wang
 Title: Reviewer Title: Project Engineer



Test Report

Issue Date: 2019-06-11

Intertek Report No. 190522010SHF-002

Test Items, Method and Results:


Test method: ASTM E492-09(R2016)^{e1} Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine

Temperature: 21 °C Relative Humidity: 80 %

Volume of the source room: 77 m³ Volume of the receiving room: 112 m³

Specimen area: 12.2 m²

Floor assembly: The system consisted of 150mm thick concrete floor and the 7.1mm ABA Flooring (including 1mm underlayment) were placed on the concrete floor.

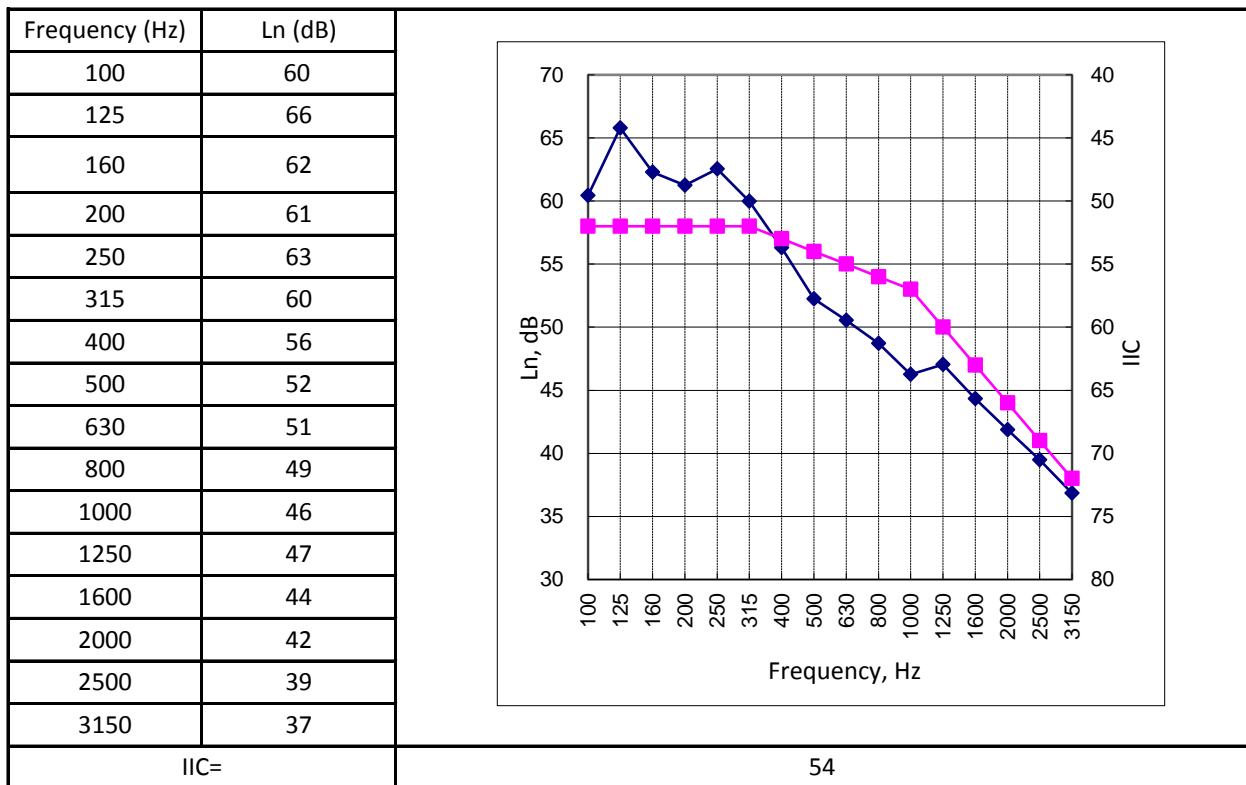

Calculated Impact Insulation Class: IIC 54

Note:

1. Ln = Normalized Sound Pressure Level for Covering over Floor System
2. Classified IIC in accordance with ASTM E989-18, Standard Classification for Determination of Impact Insulation Class.
3. The IIC was for the whole floor assembly system.

Test Report

Issue Date: 2019-06-11

Intertek Report No. 190522010SHF-002

Test Photo:



Test set up

Test Report

Issue Date: 2019-06-11

Intertek Report No. 190522010SHF-002

Appendix A: Sample Received Photo



Revision:

NO.	Date	Changes	Author	Reviewer
190522010SHF-002	2019-06-11	First issue	Mason Wang	Jodie Zhou